

SOURCE TO C216


CIRCUIT DIAGRAM

GOS-3310

GOS-233

- 1 \*ADJUSTED IN FACTORY.
- 2 CIRCUITRY ARE SUBJECT TO CHANGE WITHOUT NOTICE FOR FURTHER IMPROVEMENT.
- 3 RESISTANCE VALUES IN  $\Omega$   $\frac{1}{4}$  WATT AND CAPACITANCE IN  $\mu$ F UNLESS OTHERWISE SPECIFIED.

<b>GOOD WILL INSTRUMENT CO., LTD.</b>	
DRAWN BY	CHECKED BY
APPROVED BY	NAME
DESCRIPTION	TRIGGER & HAMP CIRCUIT
DRAWING NO	3310-02-02

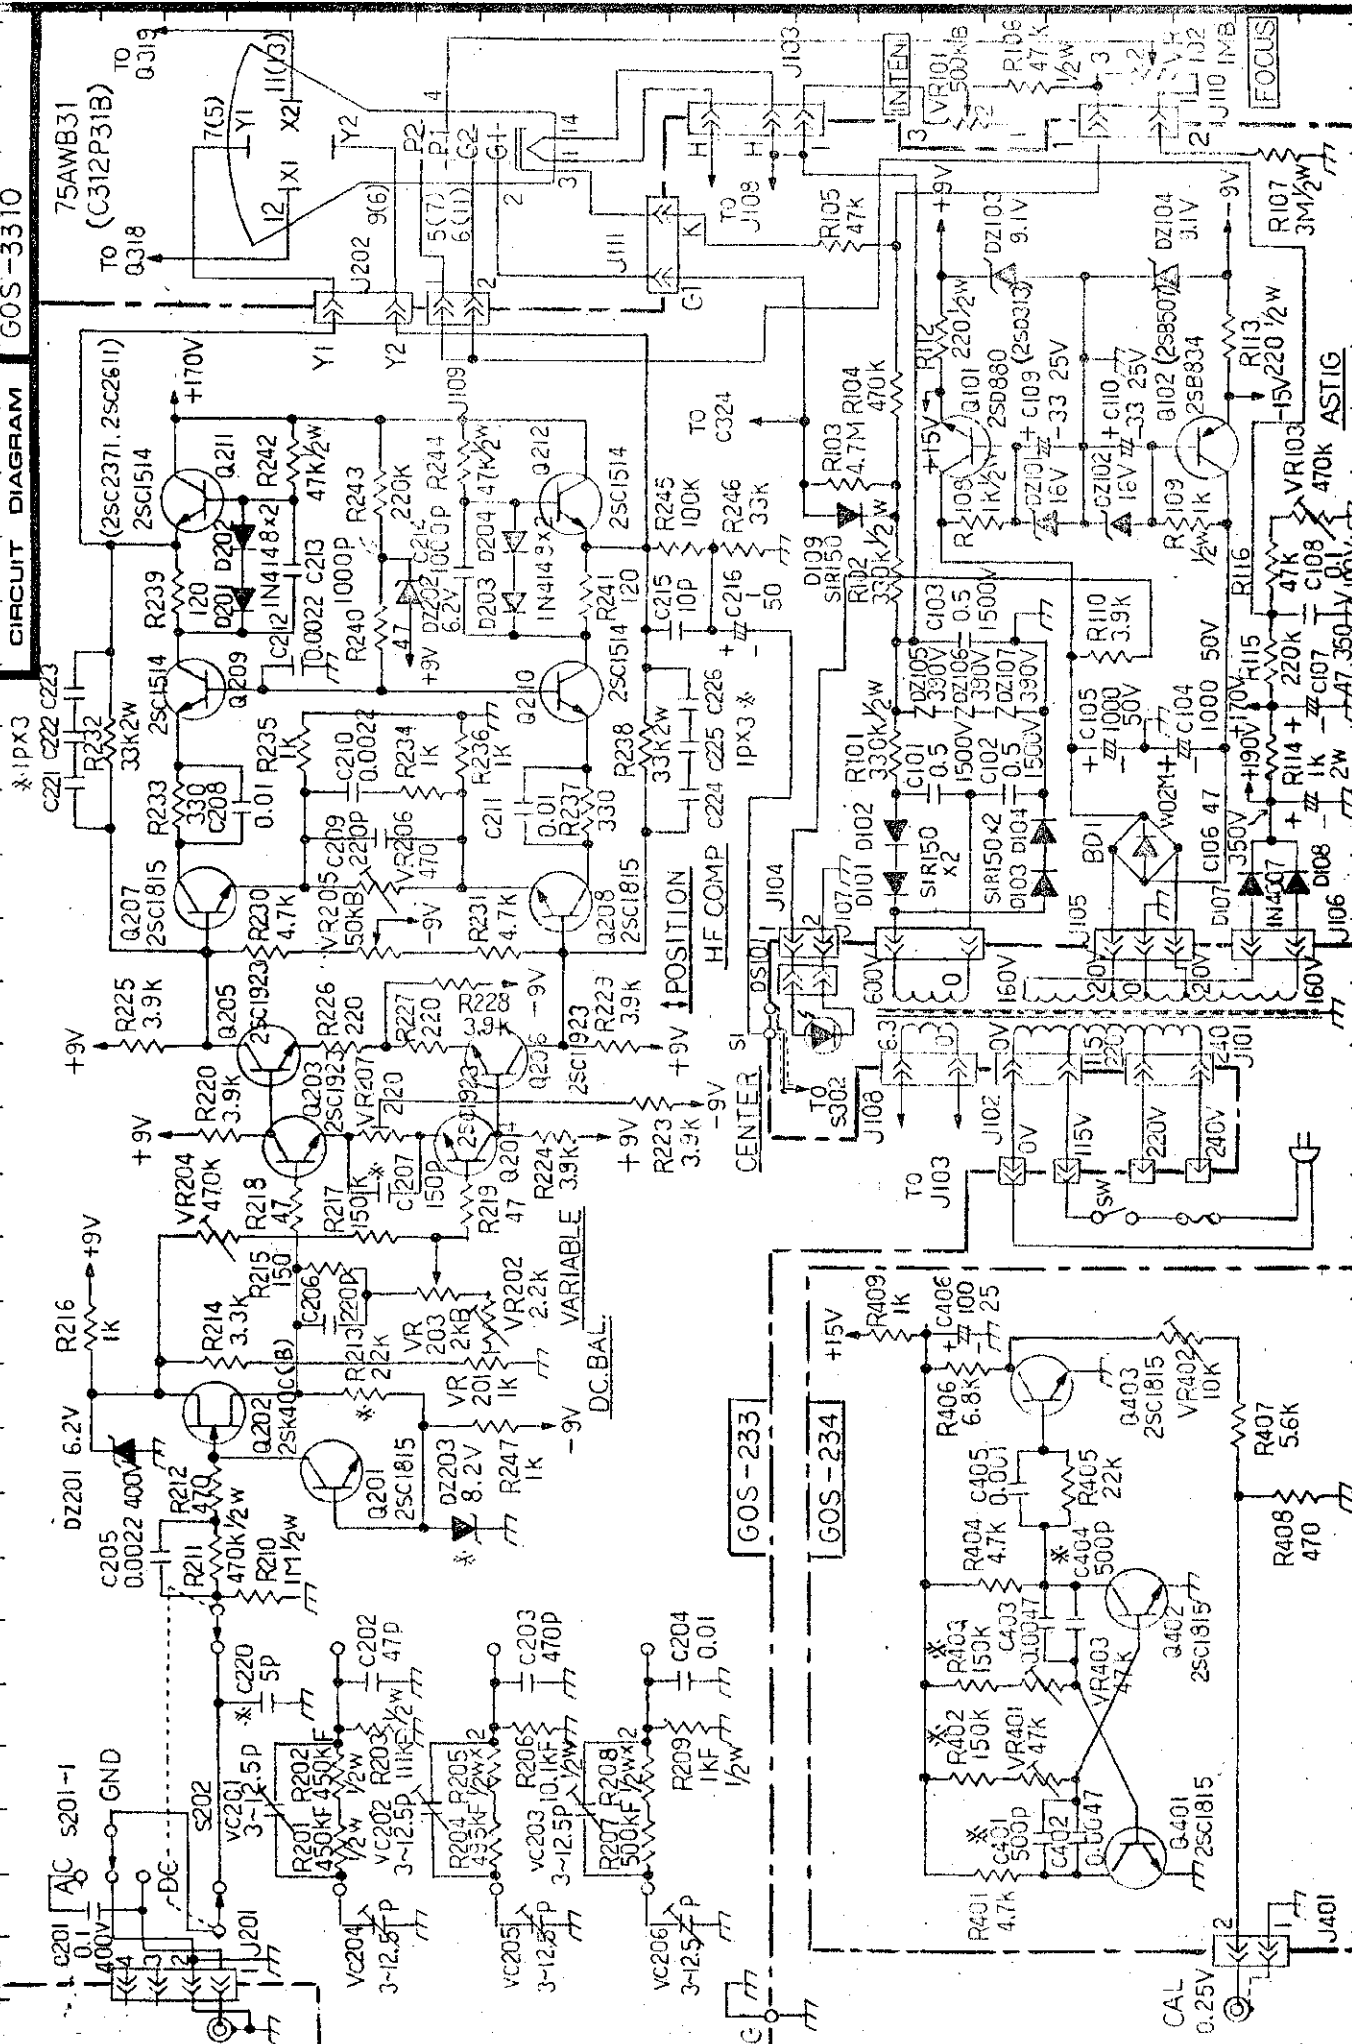

GOOD WILL INSTRUMENT CO., LTD.			OSCILLOSCOPE	
DRAWN BY	CHECKED BY	APPROVED BY	DESCRIPTION	DRAWING NO
W. J. Lee 82626	W. J. Lee 82627	S. P. Chang 2548	VERT. AMP. & POWER SUPPLY	3310-01-02

1 \* ADJUSTED IN FACTORY.  
 2 CIRCUITRY ARE SUBJECT TO CHANGE WITHOUT NOTICE FOR FURTHER IMPROVEMENT.  
 3 RESISTANCE VALUES IN Ω 1/4 WATT AND CAPACITANCE IN μF UNLESS OTHERWISE SPECIFIED.